

GENERAL NOTES

1 ALL EXTERIOR LIGHTING FIXTURES SHALL BE CONTROLLED VIA PHOTOCELL AND TIME OF DAY FUNCTION. ALL EXTERIOR LIGHTING FIXTURES SHALL BE DIMMED TO 50% ONE HOUR BEFORE CLOSING.
 2 AVERAGE FC LEVEL: 3.83FC
 MAXIMUM FC LEVEL: 37.5FC
 MINIMUM FC LEVEL: 0.25FC
 AVERAGE/MINIMUM: 18.9FC
 AVERAGE/MAXIMUM: 189.5FC


LIGHTING FIXTURE SCHEDULE										
NOTES: 1. ALL FIXTURES SHALL BE FURNISHED COMPLETE WITH ALL HARDWARE, LAMPS, HANGERS, FITTINGS, ETC. FOR A COMPLETE AND PROPER INSTALLATION.										
TYPE	DESCRIPTION	LENS	MOUNTING	LAMP	VOLT	WATT	MFR	CATALOG SERIES	APPROVED MANUFACTURERS	
G	SURFACE MOUNT LED WALL PACK	CLEAR	SURFACE	LED	120 V	37 W	USLED	WPR3-UNVL-37-2-3-0-BZ-PC	APPROVE EQUAL	
H	SURFACE MOUNT LED WALL PACK	CLEAR	SURFACE	LED	120 V	37 W	USLED	WPR3-UNVL-37-2-3-0-BZ-PC	APPROVE EQUAL	
S	POLE MOUNTED SITE LIGHTING	CLEAR	POLE	LED	120 V	100 W	USLED	RCAL-15-UNVL-33-15SP-100W-CH-HSS-BK	APPROVE EQUAL	

Harriman

DOLLAR GENERAL, 642 ROOSEVELT TRAIL

NAPLES, MAINE

Harriman Project No. 23552

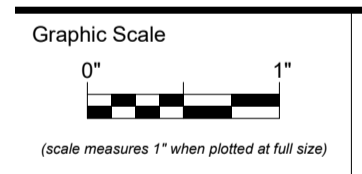

PRELIMINARY NOT FOR CONSTRUCTION

PLANNING BOARD REVIEW

JULY 7, 2024

Revision Date	Revision Description

Drawn by: ATB

LIGHTING PHOTOMETRICS PLAN

E08-1A